

## IV- - 5

## 高岡・山内・持者浄水場

### 高岡浄水場

|      |   |                            |
|------|---|----------------------------|
| 所在地  | : | 長野市若穂保科421-11              |
| 水源   | : | 湧水                         |
| 処理方法 | : | 膜ろ過方式 (UF膜)                |
| 膜面積  | : | 16 m <sup>2</sup> /本 2本    |
| 配水池  | : | 容量 62 m <sup>3</sup> /池 1池 |
| 施設能力 | : | 20 m <sup>3</sup> /日       |


### 山内浄水場

|          |   |  |
|----------|---|--|
| 所在地      | : | 長野市若穂保科字山内94-1111                                    |
| 水源       | : | 表流水  |
| 処理方法     | : | 膜ろ過方式 (UF膜)  |
| 沈澱池      | : | 容量 60 m <sup>3</sup> /池 2池                           |
| 膜面積      | : | 75 m <sup>2</sup> /本×4本 2系列                          |
| 配水池 (山内) | : | 容量 139 m <sup>3</sup> /池 1池 120 m <sup>3</sup> /池 1池 |
| 施設能力     | : | 400 m <sup>3</sup> /日                                |


### 持者浄水場 (休止中)

|       |   |                        |
|-------|---|------------------------|
| 所在地   | : | 長野市若穂保科23-2            |
| 水源    | : | 湧水                     |
| 処理方法  | : | 緩速ろ過方式                 |
| 緩速ろ過池 | : | 面積 1.44 m <sup>2</sup> |
| 配水池   | : | 容量 2.7 m <sup>3</sup>  |
| 施設能力  | : | 7 m <sup>3</sup> /日    |


### 高岡浄水場フロー

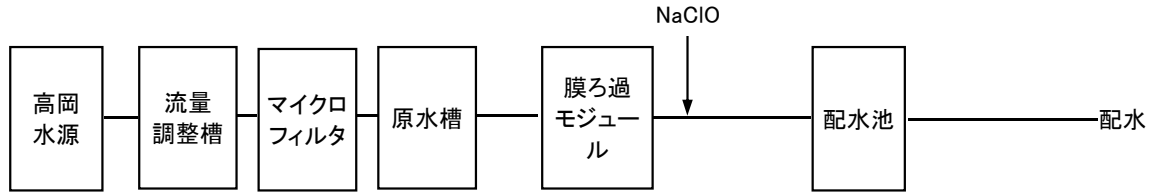

### 山内浄水場フロー

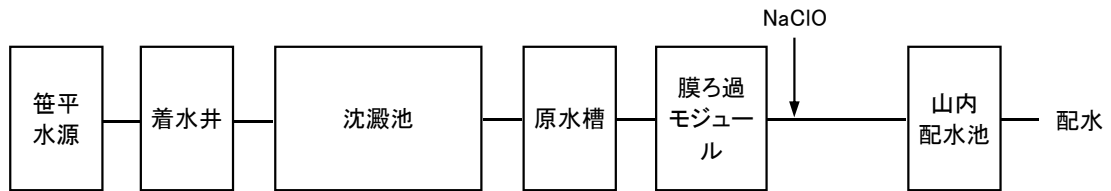

### 持者浄水場フロー

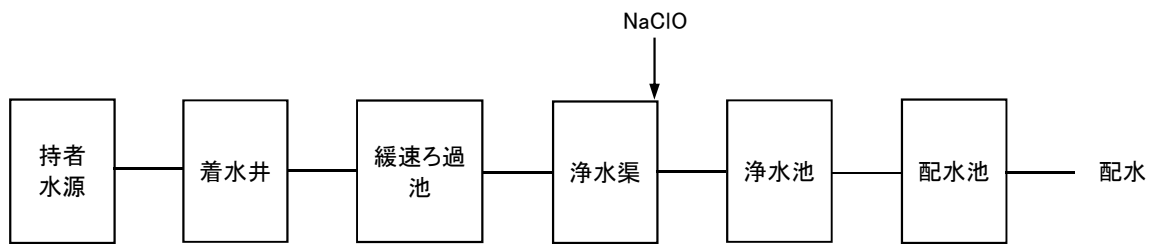





山内浄水場 原水

令和2年度

Table with columns for sampling date, unit, standard, and various water quality parameters (R2.5.25, R2.7.14, R2.9.10, R2.11.11, R3.1.12, R3.3.3, highest, lowest, average, frequency) for items like temperature, bacteria, heavy metals, pesticides, and nutrients.

山内浄水場 浄水

令和2年度

Table with columns for 区分 (Sampling Point), 採水年月日 (Sampling Date), 単位 (Unit), 基準(目標) (Standard/Target), R2.5.25, R2.7.14, R2.9.10, R2.11.11, R3.1.12, R3.3.3, 最高 (Max), 最低 (Min), 平均 (Avg), and 回数 (Frequency). Rows include environmental data like temperature and weather, and water quality data for various substances such as bacteria, heavy metals, and nutrients.